


TYPICAL RETAINING WALL SECTION

NOT TO SCALE


NOTES:

- 1. REFER TO SITE PLAN (BY OTHERS) FOR WALL LOCATION
- CONCRETE - MIN. 2000 PSI
- ALLOWABLE SOIL BEARING PRESSURE ASSUMED 2500 PSF CONTRACTOR TO VERIFY
- PROVIDE EXPANSION JOINTS @ 75' O.C. MAX.
- PROVIDE CONTROL JOINTS @ 30' O.C. MAX.
- WALL MAY BE FACED WITH STONE VENEER (OPTIONAL)
- PROVIDE INSERTS IN TOP OF WALL FOR GUARDRAIL (OPTIONAL)
- IF STORMSHADE FENCE IS TO BE USED, CONTACT ENGINEER FOR ANALYSIS OF WINDLOADS
- WALL IS DESIGNED AS UNREINFORCED

Odin Engineering
P.O. Box 1096
Lynnfield, MA 01940-3096
PH: (781) 592-8385
FAX: (781) 595-8948



Structural Engineering
Civil Engineering
Building Inspections
Code Consulting

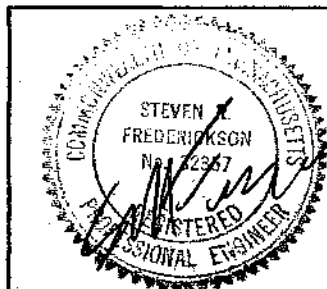

19 BASSWOOD LANE
ANDOVER, MA

PROPOSED
RETAINING WALL

Scale: NTS

Date: 11/26/04

By: SRF

Sheet 1 of 1